



DIGIT	1
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	PM
12	GROUND

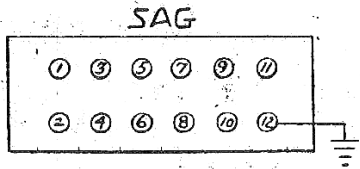

INPUTS 11-20 INCLUSIVE } SOCKET PANEL B PX-11-103
 OUTPUTS 11-20 INCLUSIVE }

INPUTS 1-10 INCLUSIVE } SOCKET PANEL A PX-11-102
 OUTPUTS 1-10 INCLUSIVE }

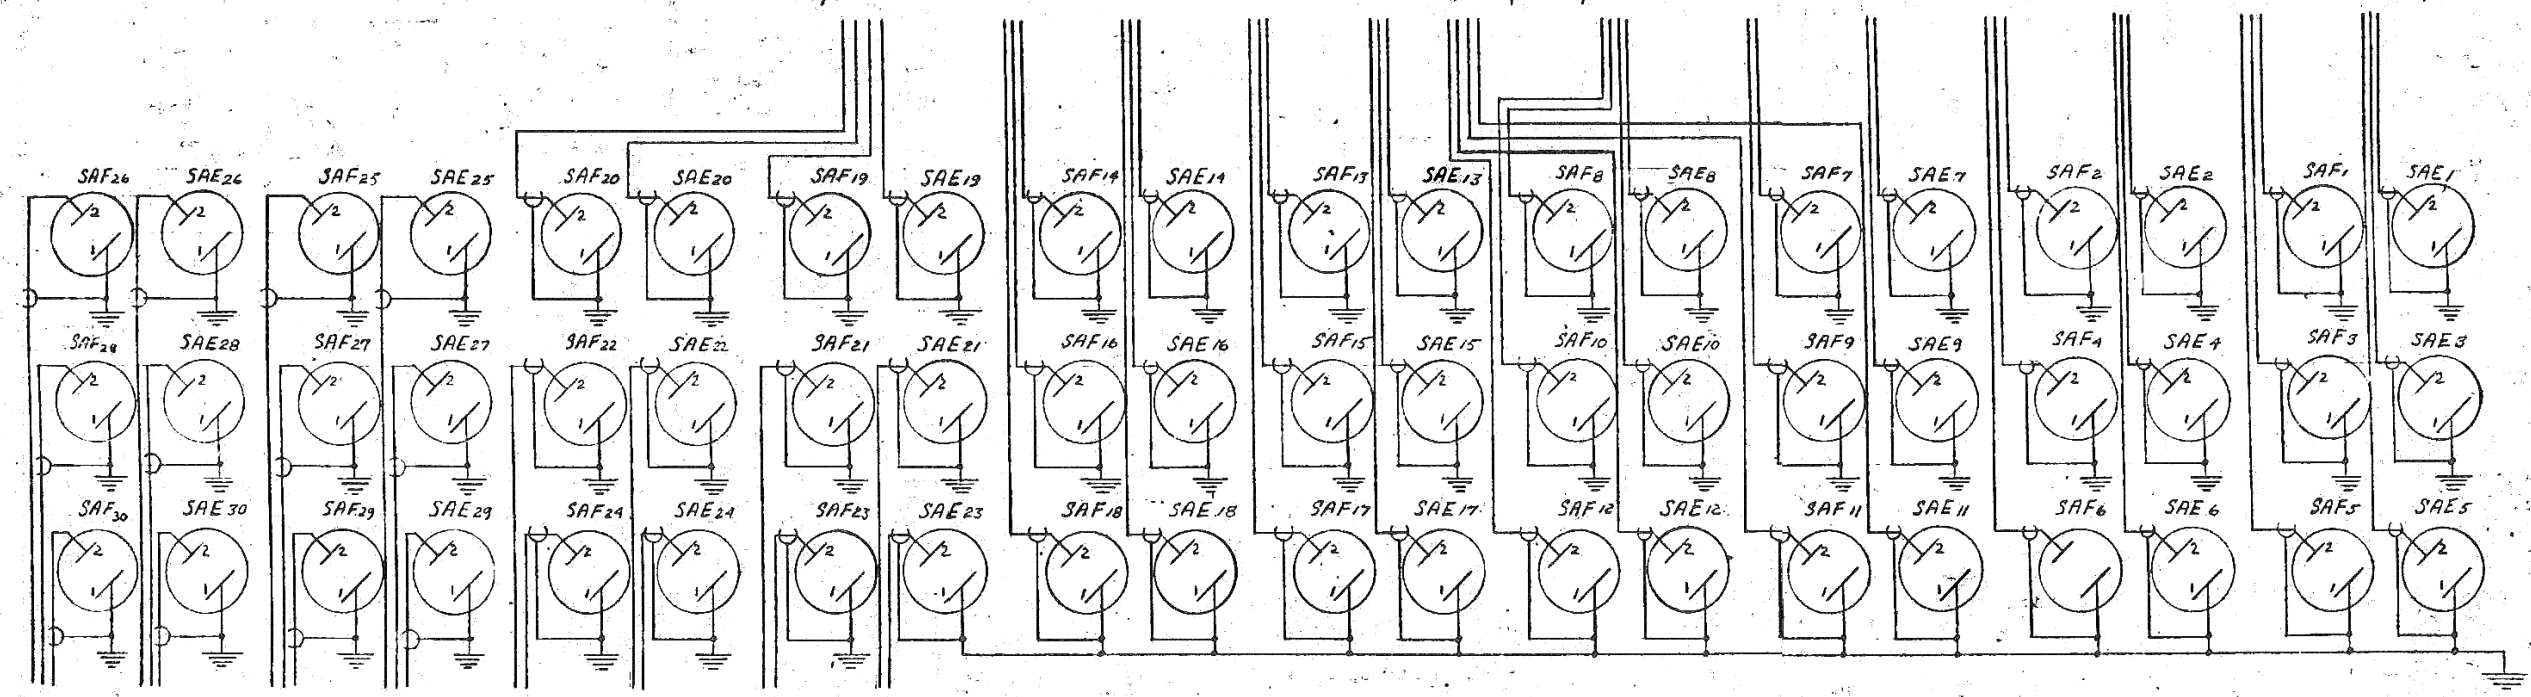

INPUTS 21-30 INCLUSIVE } SOCKET PANEL C PX-11-105
 OUTPUTS 21-30 INCLUSIVE }

1
 TERMINAL 1 ON ALL 3302
 PLUGS GROUNDED

2
 TIME METER WIRING REVISED
 FOR WYE CONNECTION OF
 A.C. POWER

3
 Comm'n g 18 Jan 47

MOORE SCHOOL OF ELECTRICAL ENGINEERING
 UNIVERSITY OF PENNSYLVANIA

CONSTANT TRANSMITTER FRONT PANEL #1

MATERIAL	FINISH	
Drawn by: jgp Nov 26, 1944	Checked by: RFS 27 Nov 44	Approved by: PX-11-101