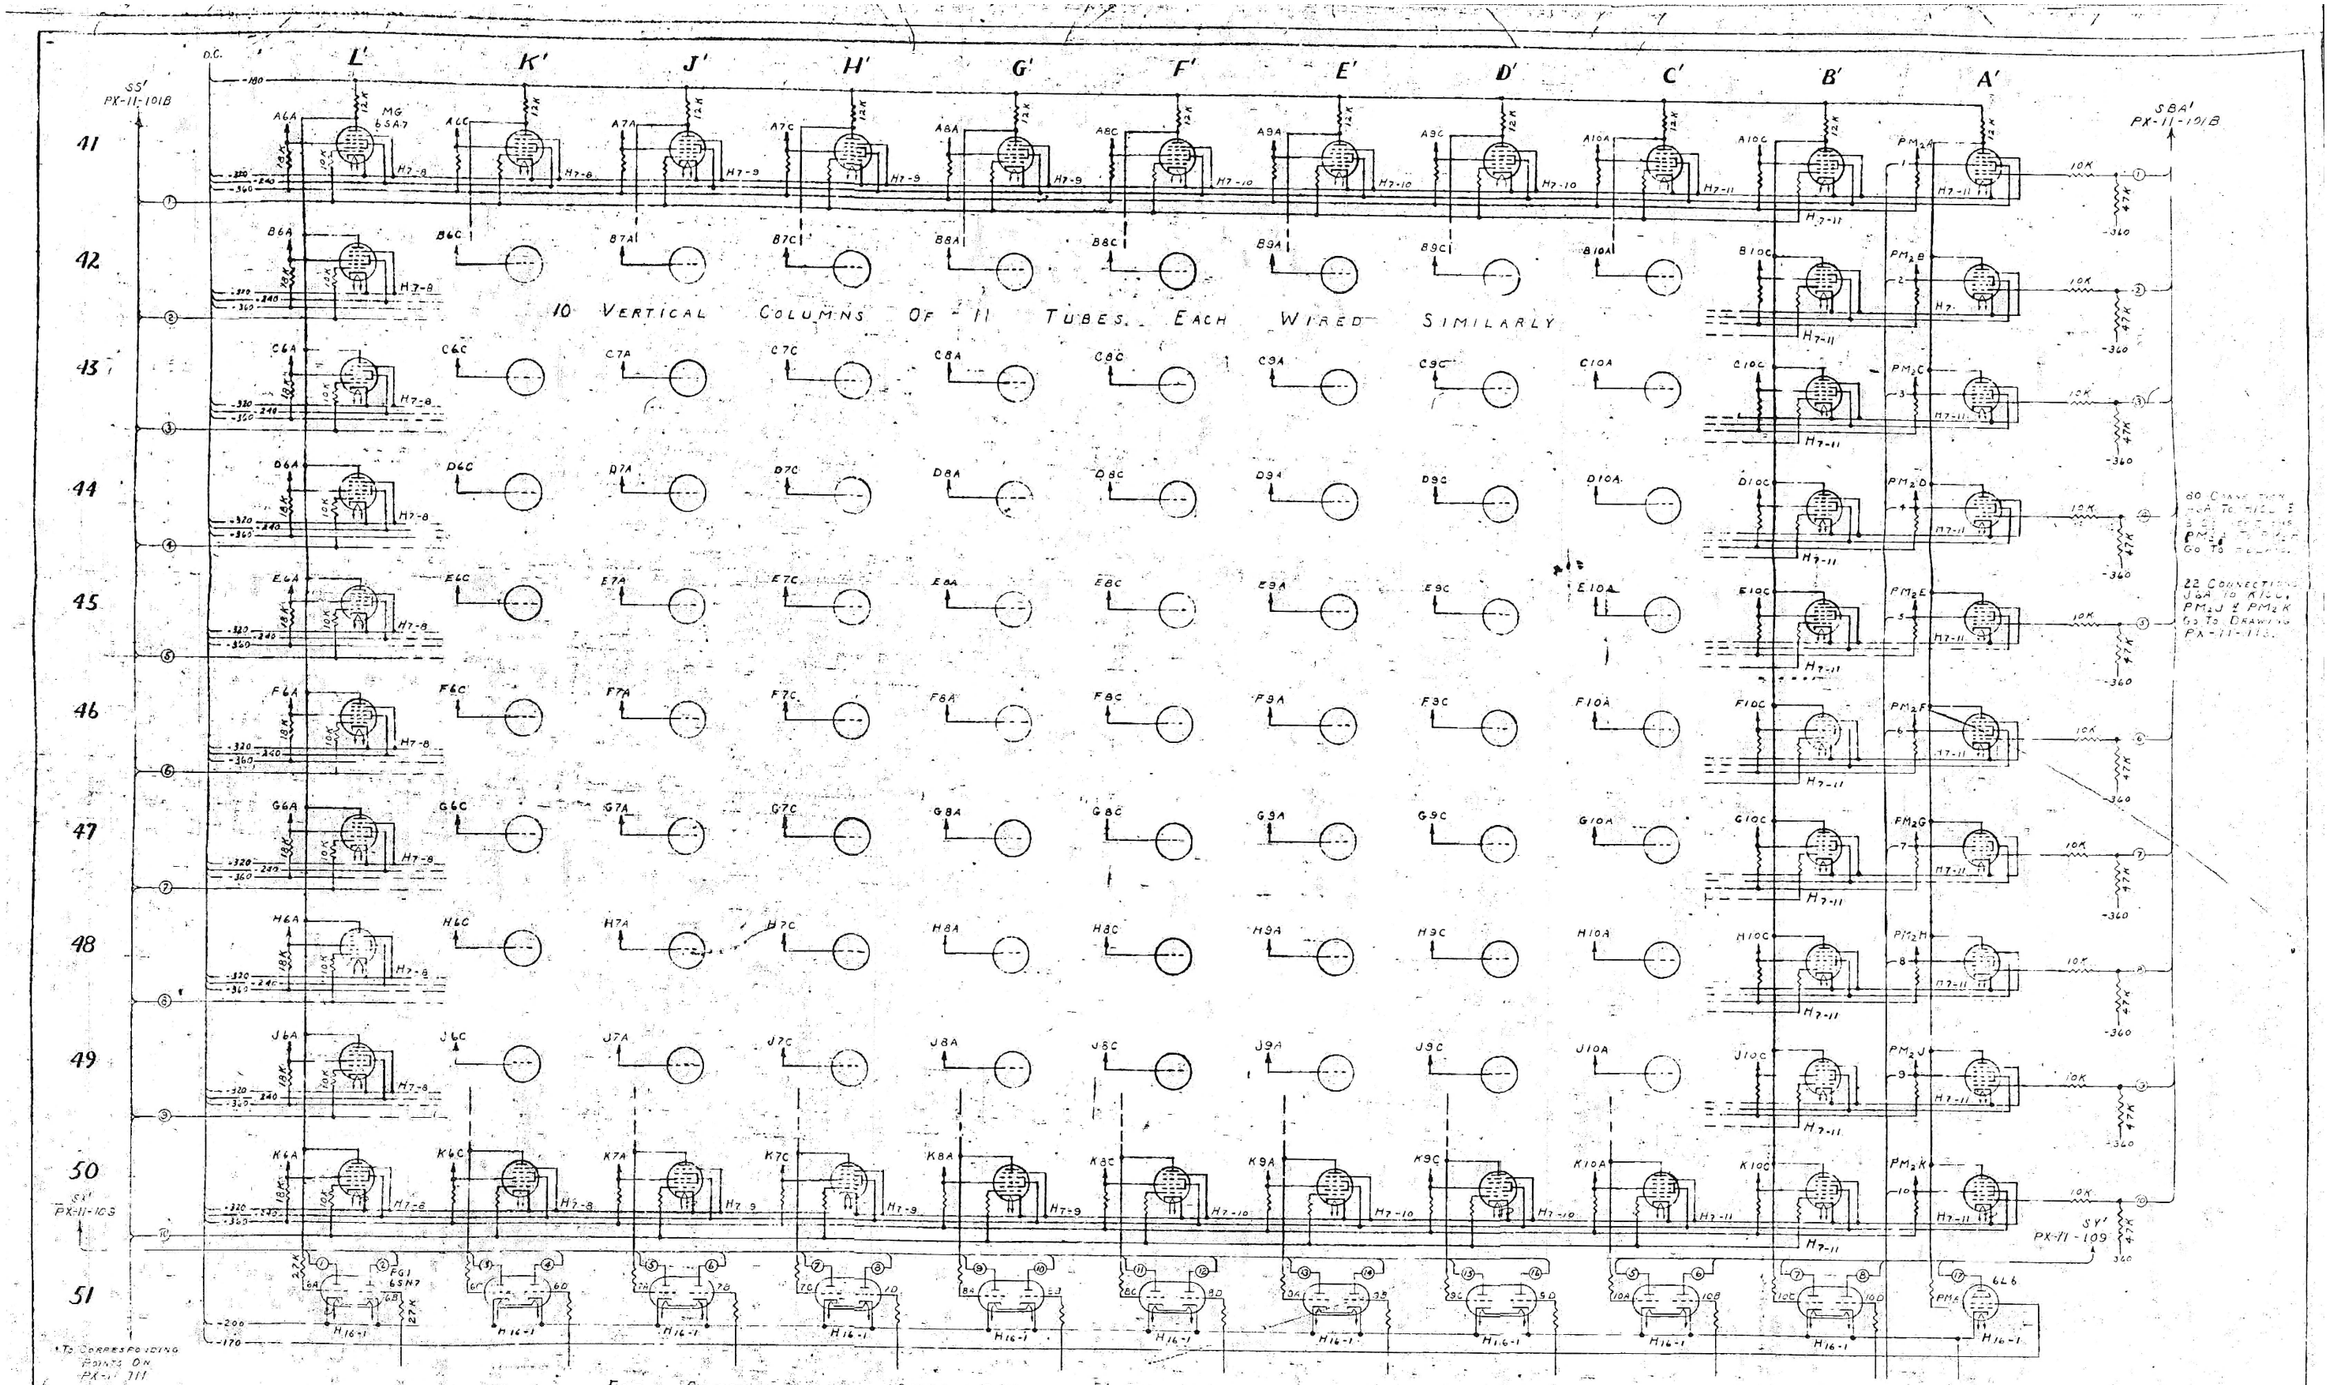

-375 Changed To -360. 2-70K Grid Resistors Changed To 10K. Connections Revised. Grid Leads Added.	R.T. Allen 2/14/44	1
Tube Numbering System Added.	R.T. Allen 5/5/44	2
Resistance Chart Added.	Wm. Chase 6/15/44	3

MOORE SCHOOL OF ELECTRICAL ENGINEERING
UNIVERSITY OF PENNSYLVANIA

Constant Transmitter Gate Chassis C - Panel 2

Material	Finish	Scale

Drawn by:	Checked by:	Approved by:	
C.J. McC Sept. 27, 1944	R.T. 10/4/44	21 Dec 44	PX-11-110