REVISIONS:

"L" & "J" CABINETS REVISED
AWB 5/14/45 | 1

TWO CONDENSERS ADDED ON W - PANEL 2
SEMI-FINAL REVISION
AWB 6/19/45 | 2

I SUPPLY HAD 32 COND.
W SUPPLY HAD 34 COND.
AWB 7/9/45 | 3

NOTE REGARDING D.C. UNDER VOLTAGE RELEASE RELAYS ADDED.
J. Cummings 4-17-46 | 4

I SUPPLY WAS 36 X 125
H. Jones 7-17-46 | 5

CONDENSERS WERE MOUNTED ON 3 PANELS
J. Cummings 4 JUN 47 | 6

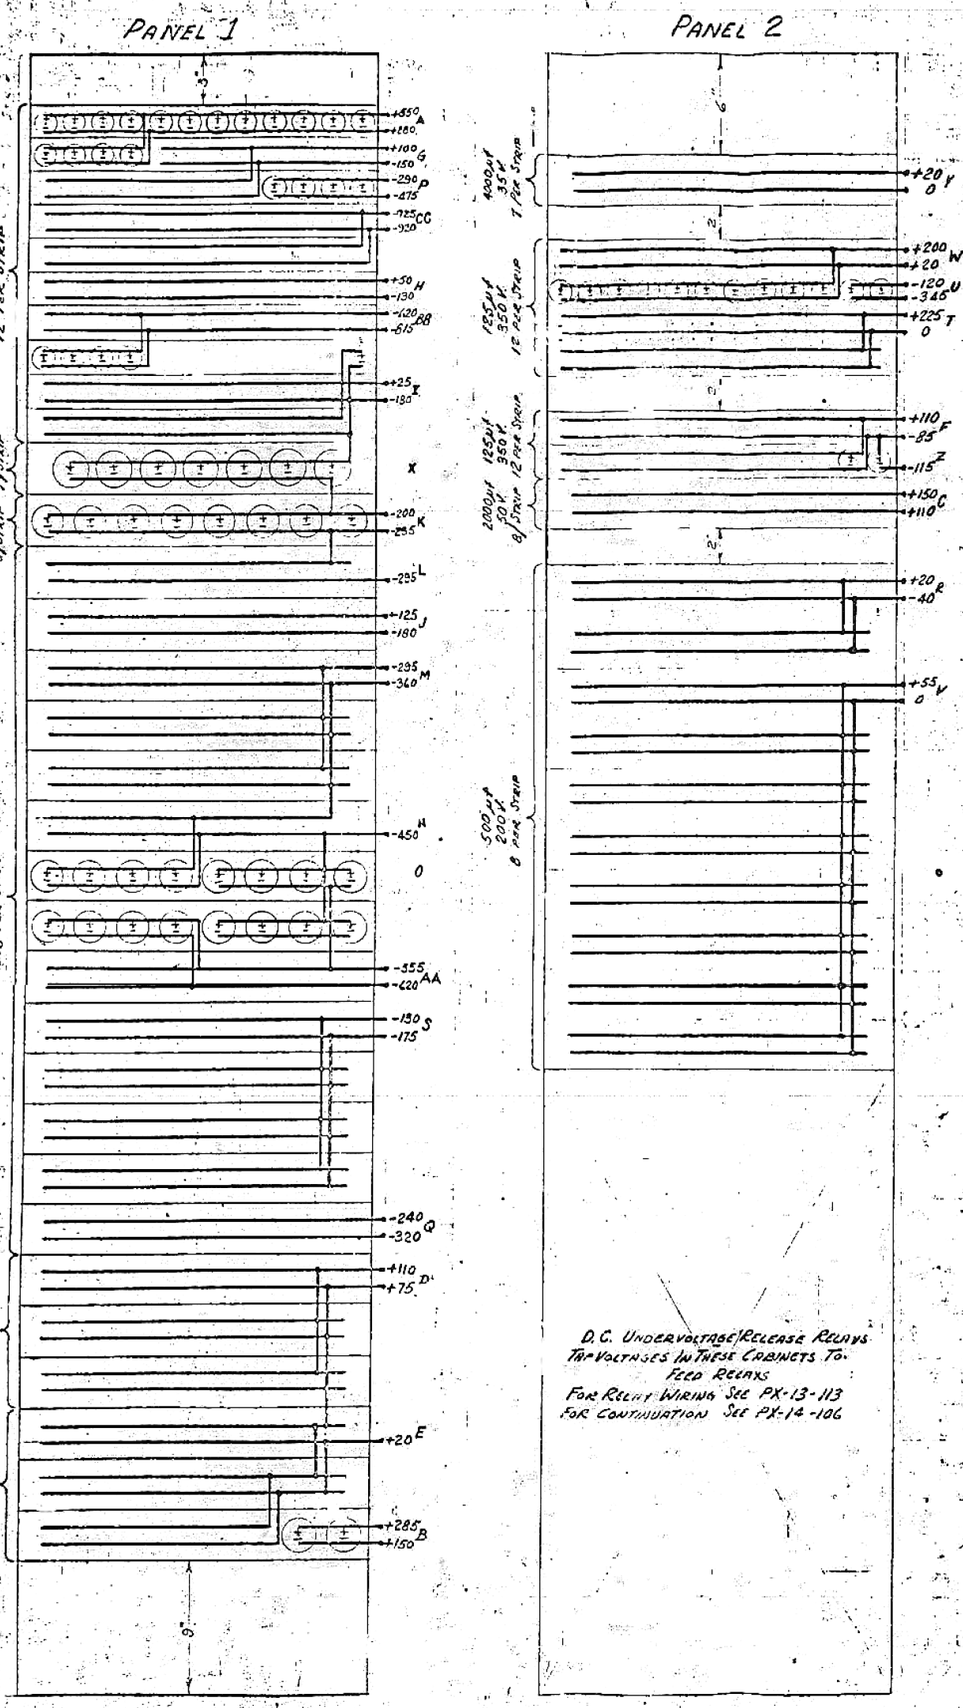

D.C. UNDERVOLTAGE RELEASE RELAYS
TAP VOLTAGES IN THESE CABINETS TO FEED RELAYS
FOR RELAY WIRING SEE PX-13-113
FOR CONTINUATION SEE PX-14-106

NOTE: CONDENSERS TO BE CONNECTED TO LINE SIDE OF D.C. W FUSE CABINET
FOR WIRE SIZE SEE PX-13-102

MOORE SCHOOL OF ELECTRICAL ENGINEERING
UNIVERSITY OF PENNSYLVANIA

POWER SUPPLY CONDENSER WIRING DIAGRAM

Drawn by: J.P. 5/18/45
Checked by: AWB 6/19/45
Approved by: 7/11/45
SCALE
PX-