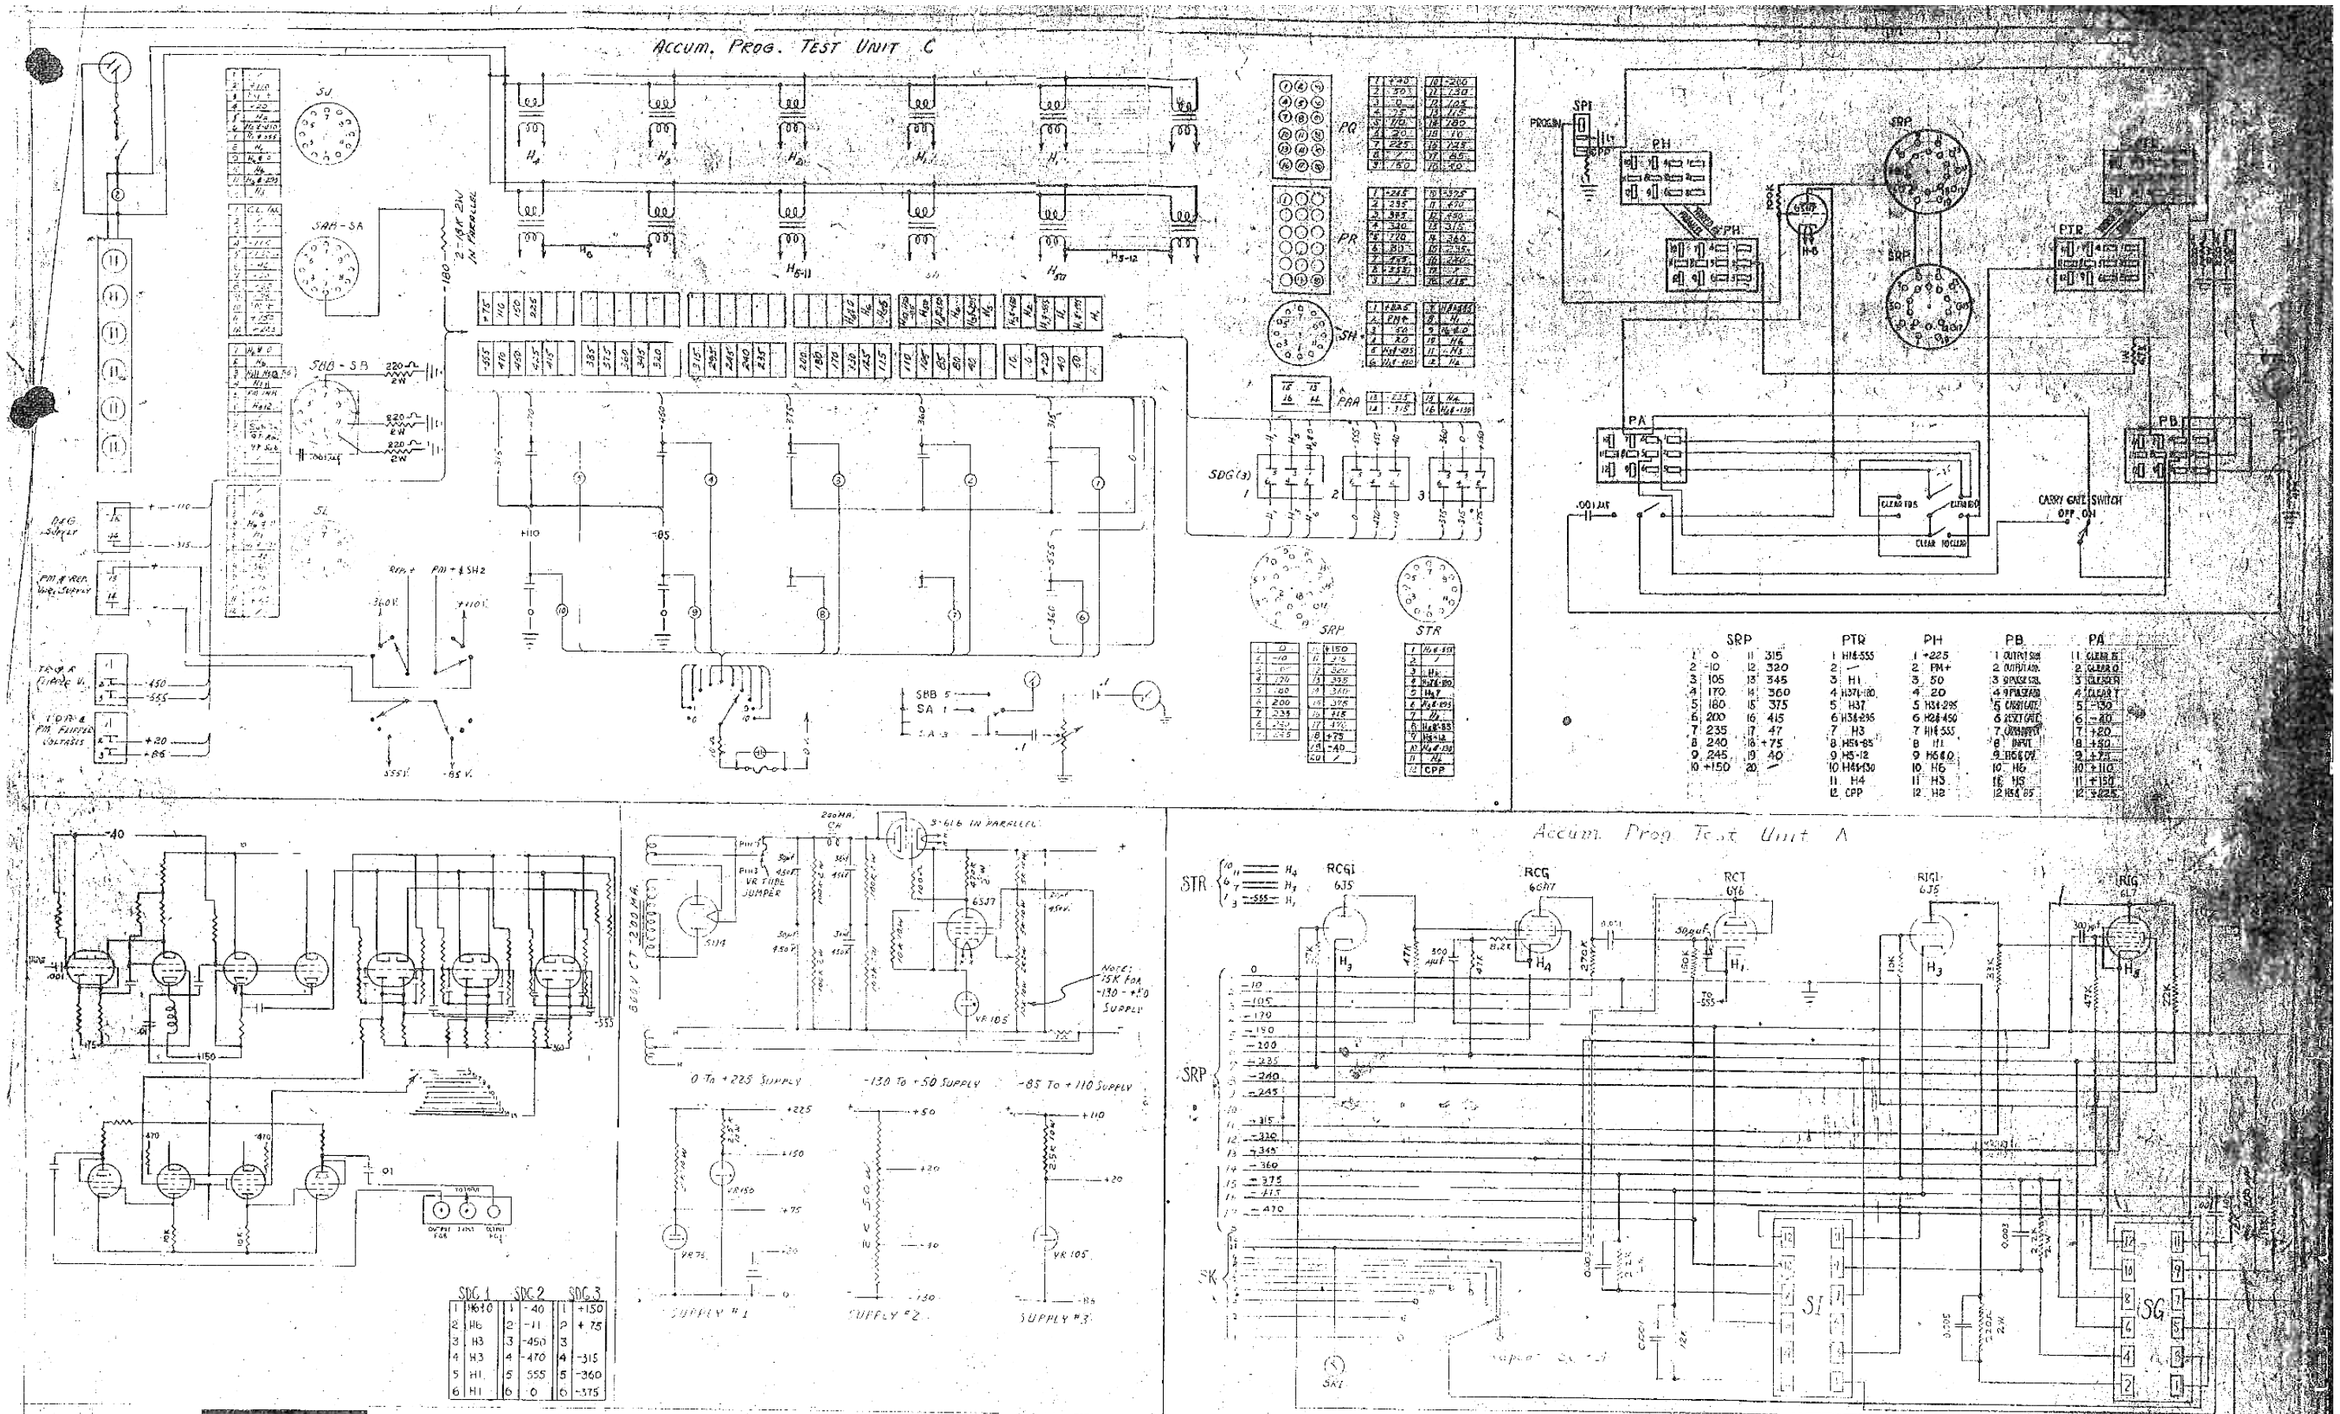
Accum. Prog. Test Unit C
SU
SAH - SA
SUB - SB
SL
PQ
PR
SH
PAA
SDG (3)
SRP
STR
SPI
PROGRAM
PH
PTR
PA
PB
CARRY GATE SWITCH
OFF ON
SBB
SA
Accum. Prog. Test Unit A
RCG1 6J5
RCG 6GH7
RCT 6J6
RIG1 6J5
RIG 6L7
SI
SG
SK
SDG 1
SDG 2
SDG 3
0 To +225 Supply
-130 To +50 Supply
-85 To +110 Supply
Supply #1
Supply #2
Supply #3
NOTICE
This print has been reduced to 50% of its original size.
Campbell Photo
002358
No. 2193
MOORE SCHOOL OF ELECTRICAL ENGINEERING
UNIVERSITY OF PENNSYLVANIA
ACCUMULATOR PROGRAM TEST EQUIPMENT, CIRCUIT
MATERIAL
FINISH
Drawn by: RFS 21 JUNE 44
Checked by:
Approved by: