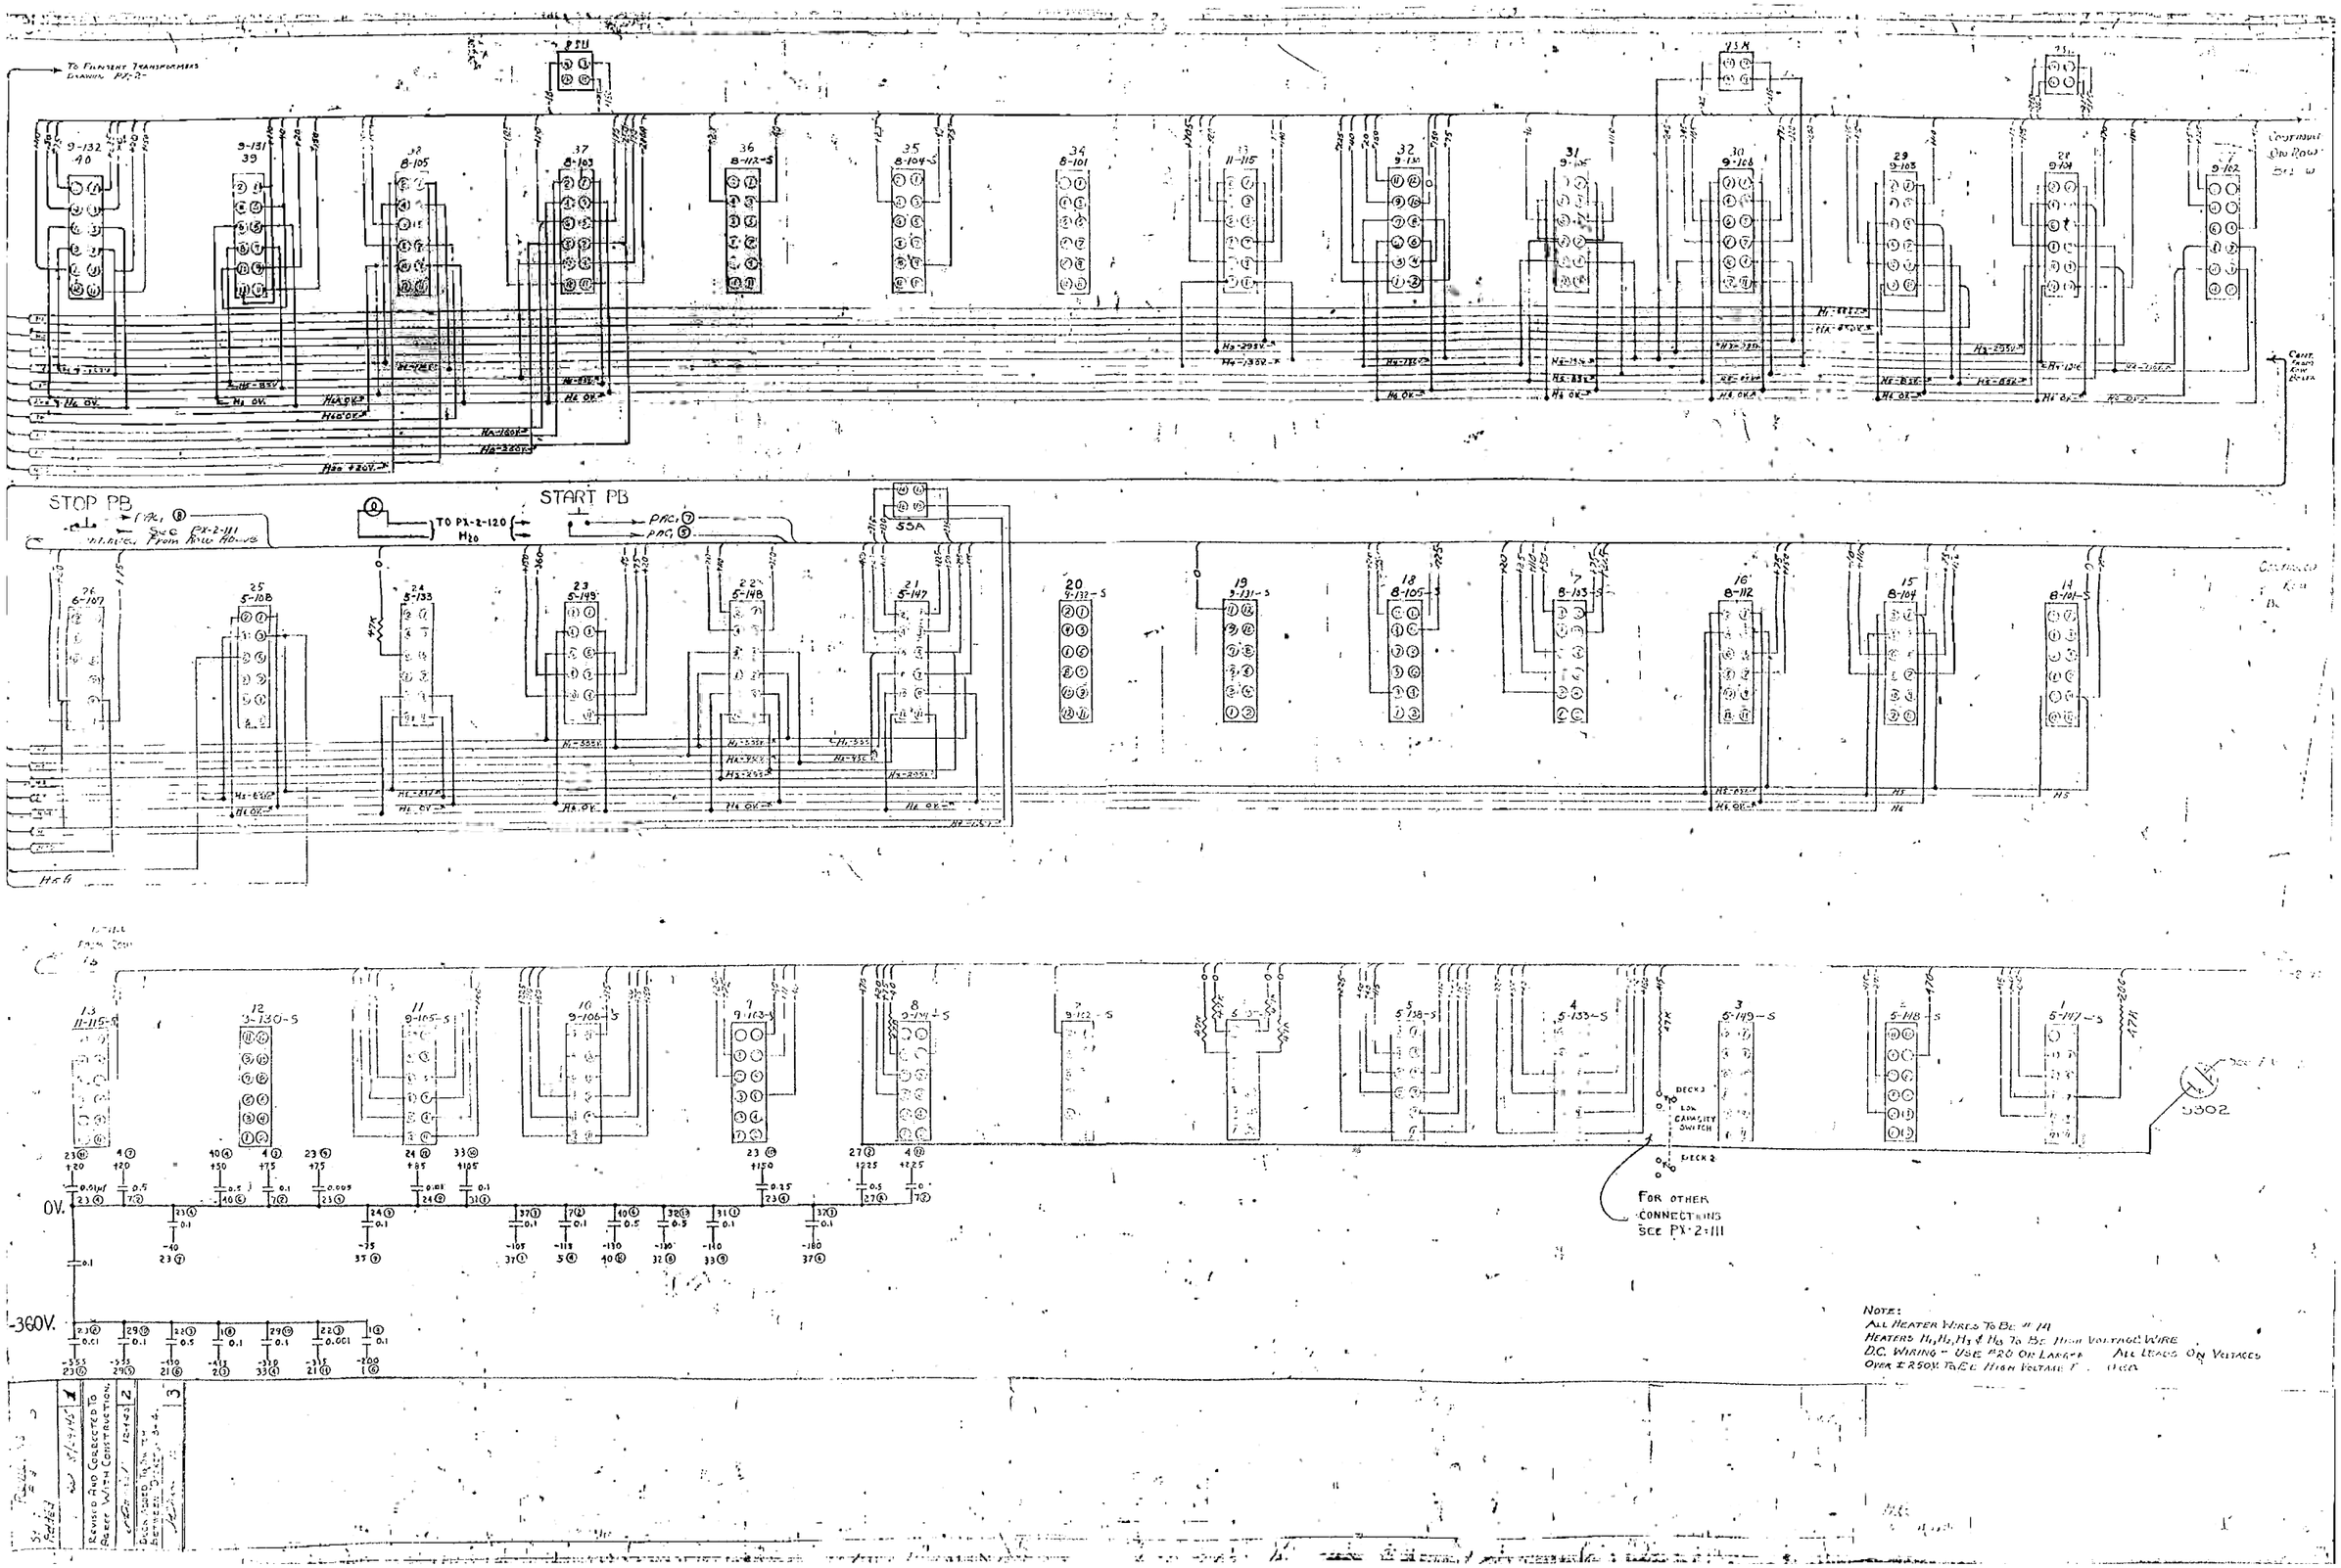
To Filament Transformers Drawing PX-2-
STOP PB
START PB
To PX-2-120
See PX-2-111
From Fire House
SSA
SSB
Continued On Row
For other connections see PX-2:111
Low Capacity Switch
Deck 1
Deck 2
0V.
-360V.
Note:
All Heater Wires To Be # 14
Heaters H1, H2, H3 & H6 To Be High Voltage Wire
D.C. Wiring - Use #20 Or Larger
All Leads On Voltages Over ± 250V. To Be High Voltage