


MOORE SCHOOL OF ELECTRICAL ENGINEERING
UNIVERSITY OF PENNSYLVANIA

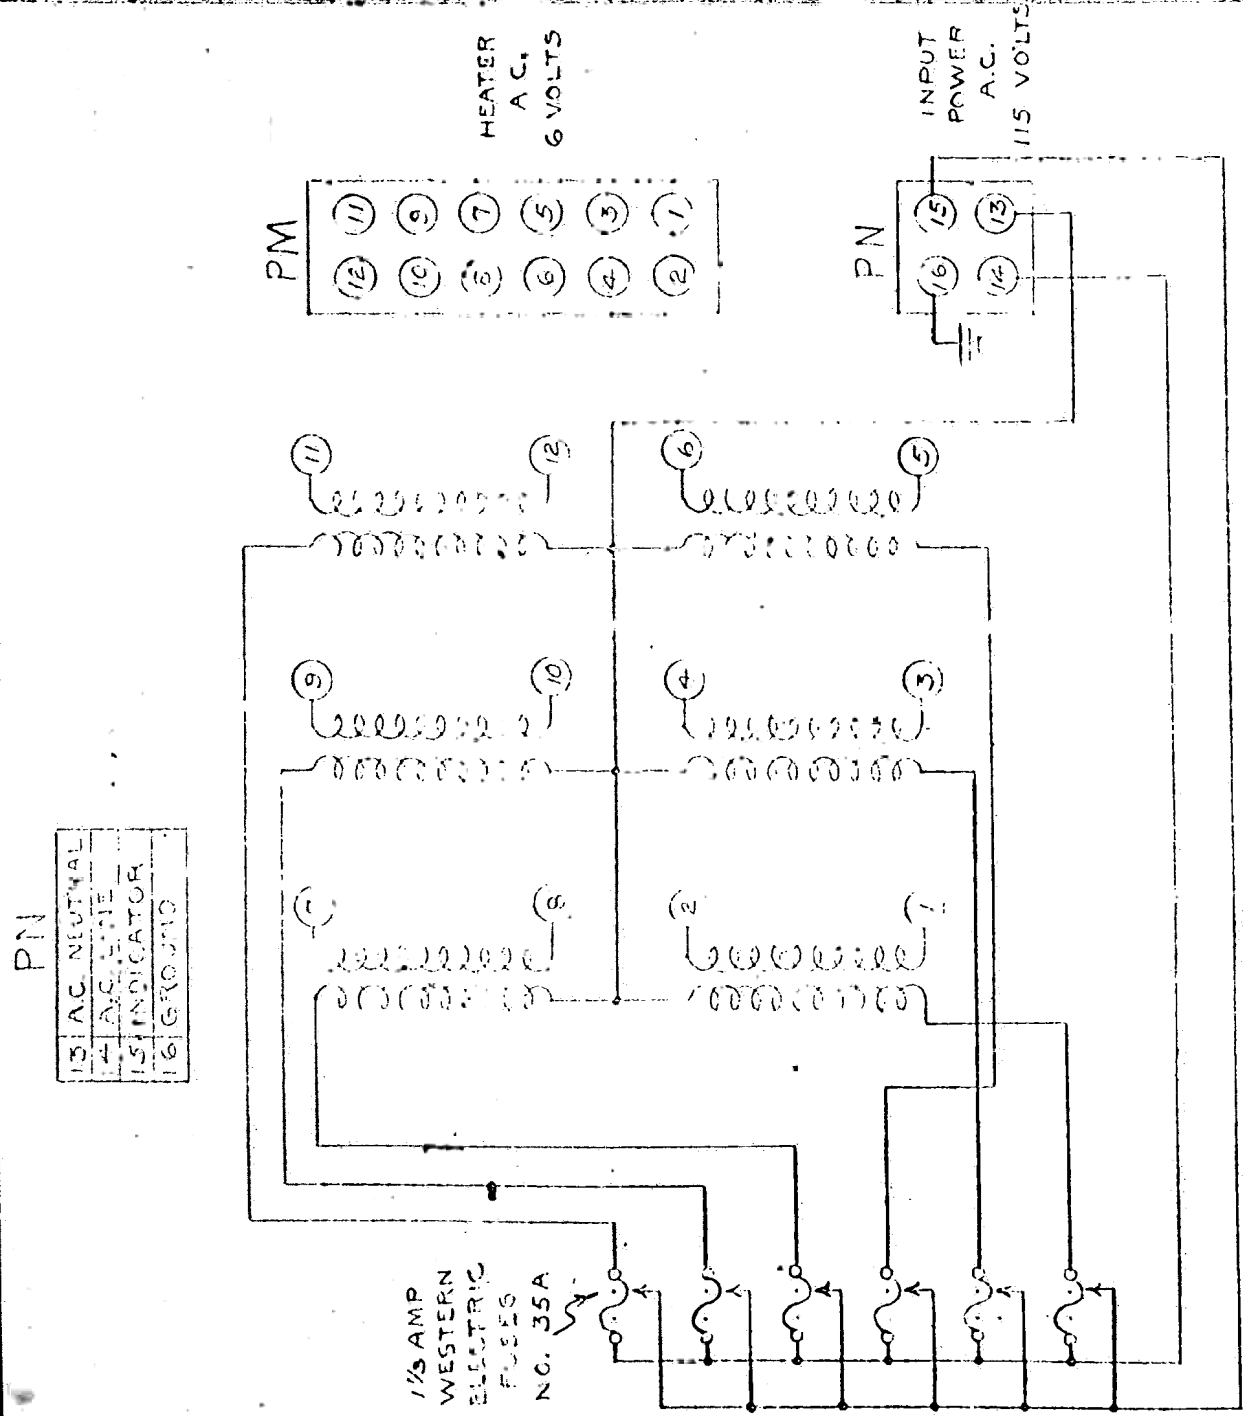

13	AC NEUTRAL
14	AC LINE
15	INDICATOR
16	GROUND

REDRAWN AND FUSES ADDED	2
CONNECTIONS TO FUSES REVISED	3

DRAWN BY	H.M.M.
CHECKED BY	J.H.O.
APPROVED BY	

TRANSFORMER PLUG-IN UNIT

SCALE	PX-5-113
-------	----------

211-2-14