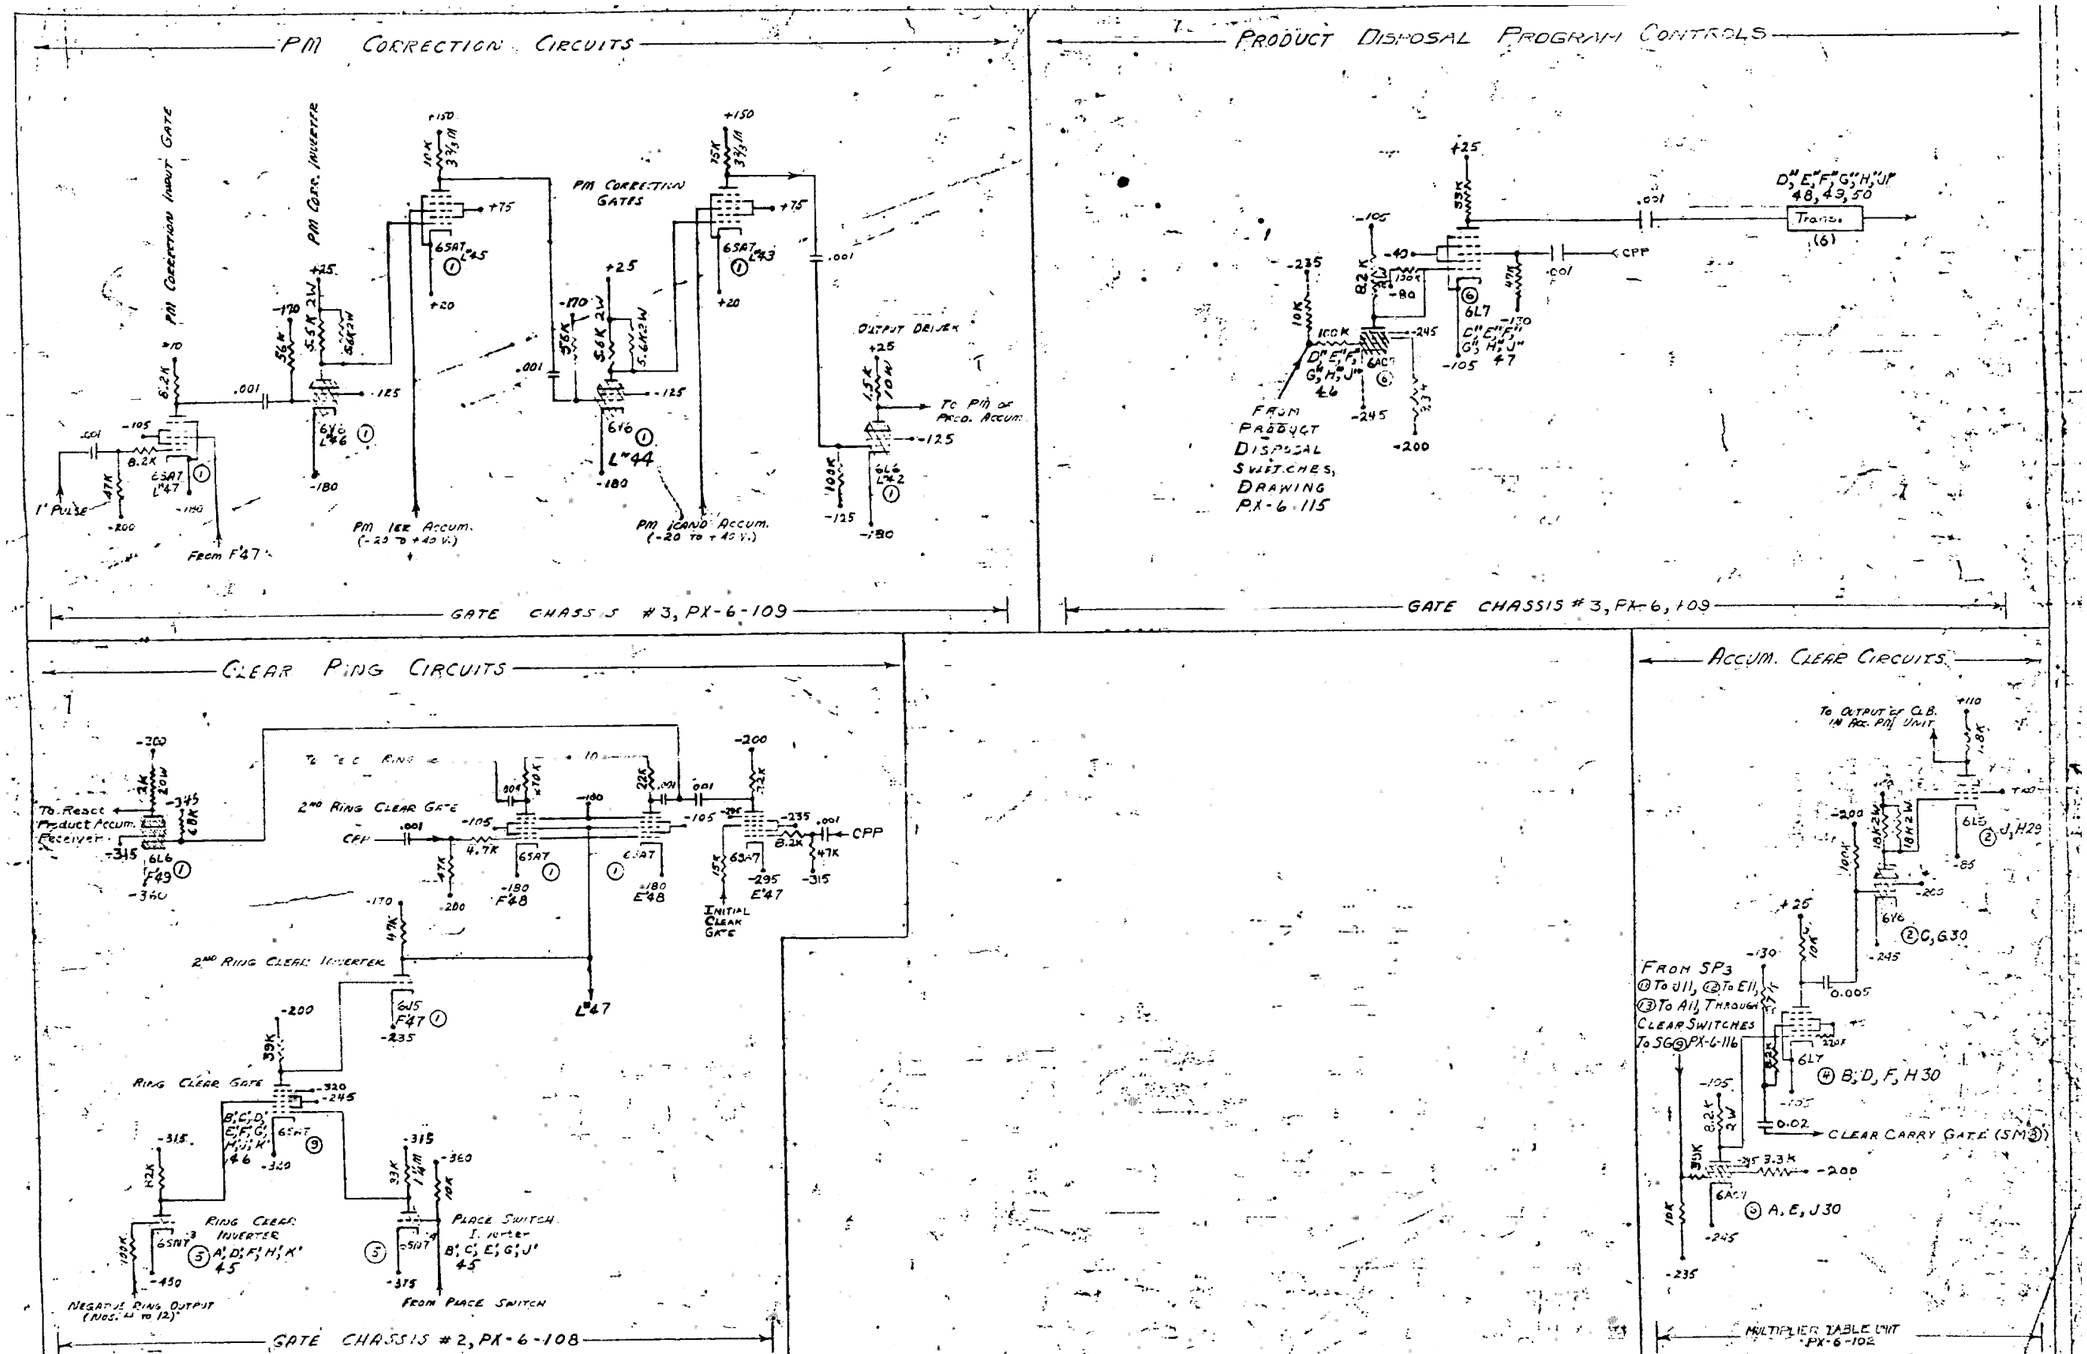

REVISIONS					
1	Revised 10K Grid Res. - Output Driver. June 9, 1945	2	Tube Location Numbers Added. GJT-45	3	Accumulator Clear Circuits Released from A1, L11, To A7N30 & H7N29. F.R.M. 8-2-45
4	Screens Changed on All Tubes 8-28-45. 8.2K Accum. 0.005 Changed to 0.02 on 46273 in Accumulator Clear Circuits. 100K Changed to 220.	5	Changed grid resistor on A, E, J30 from 100K to 39K.	6	Voltage to plus 100K To Grid of Output Driver PM Circuit was -170.

MOORE SCHOOL OF ELECTRICAL ENGINEERING
UNIVERSITY OF PENNSYLVANIA

MULT. CROSS SECTION, CONT'D.

Material	Finish	Scale

Drawn by:	Checked by:	Approved by:	
MSM 10-23-45	YRS 12-15-45	AWS 12-15-45	PX-6-112(B)